ADDENDUM



SECTION 00 91 11.03 - ADDENDUM 003

OWNER INDIANA UNIVERSITY

20250312 - BL017 STUDENT BUILDING

(FRANCES MORGAN SWAIN) - F100

ANTHROPOLOGY GEOGRAPHY LABS

A/E PROJECT 5-6672

PURPOSE THIS ADDENDUM SHALL FORM PART OF THE

BIDDING DOCUMENTS. CHANGES, ADDITIONS,

CLARIFICATION OR DELETIONS HEREIN

SUPERSEDE THE DRAWINGS AND

SPECIFICATIONS. BIDDERS SHALL INCLUDE

ON THE PROPOSAL FORM

ACKNOWLEDGEMENT OF THE RECEIPT OF

THIS ADDENDUM.

ATTACHMENTS

PROJECT

REISSUED SHEETS: A1.1.0

ARCHITECT-ENGINEER GMB

317.641.0674 WWW.GMB.COM

ADDENDUM



GENERAL

1.1 BIDDER QUESTION & ANSWER (NEW)

Q: Referencing Sheet A1.1.0 Elevations 1,2,3,4. Just want to confirm that the new TRES-1 countertops and backsplashes will be furnished and installed by the Owner's vendor?

A: The TRES-1 countertops and backsplashes on A1.1.0 are by GC. They are associated with the salvaged casework that is by GC; therefore the GC is to provide the countertops here. Spaces with all new casework has casework by the Owner's vendor.

1.2 BIDDER QUESTION & ANSWER (NEW)

Q: Contractor is asking for the acceptability of mounting aluminum wire mold boxes over existing receptacles and back boxes if the layout matches. The intention would be to reduce the amount of surface mount aluminum raceway and provide a more aesthetically pleasing installation that would also show cost savings back to the owner. Review and advise of any questions or concerns

A: If the layout and elevations match, this is acceptable. Several wiremold and outlet locations are intended to be at specific elevations to be above counters and/or below shelving, verify alignment with Architectural elevations.

1.3 BIDDER QUESTION & ANSWER (NEW)

Q: Will the building elevator be available for transporting materials by the contractor throughout the project?

A:Yes, the building elevator is available for transporting materials. The elevator must be protected throughout the duration of the project, including floor protection inside and outside of the elevator.

SHEET CLARIFICATIONS / REVISIONS

2.1 SHEET A1.1.0 - GROUND FLOOR PLAN & DOOR SCHEDULE (REISSUED)

A. Note clarified for who provides countertops in Dry Lab 028

END OF SECTION


EKS/AN/GP DRAWN REVIEWED SSB PROJECT NO.

NO PART OF THIS DRAWING MAY BE USED OR REPRODUCED IN ANY FORM OR BY ANY MEANS, OR STORED IN A DATA BASE OR RETRIEVAL SYSTEM, WITHOUT PRIOR WRITTEN GMB COPYRIGHT © 2025

ALL RIGHTS RESERVED GROUND FLOOR PLAN & DOOR SCHEDULE

TYPE BACK PLATE ROOM SIGNAGE COMMENTS ONE SIGN EACH SIDE OF DOOR 025A FOR TOTAL

ROOM SIGNAGE SCHEDULE - GROUND FLOOR GMB ROOM SIGNAGE **GMB ROOM NAME** NUMBER CLASSROOM ARCHIVES / WORK LAB

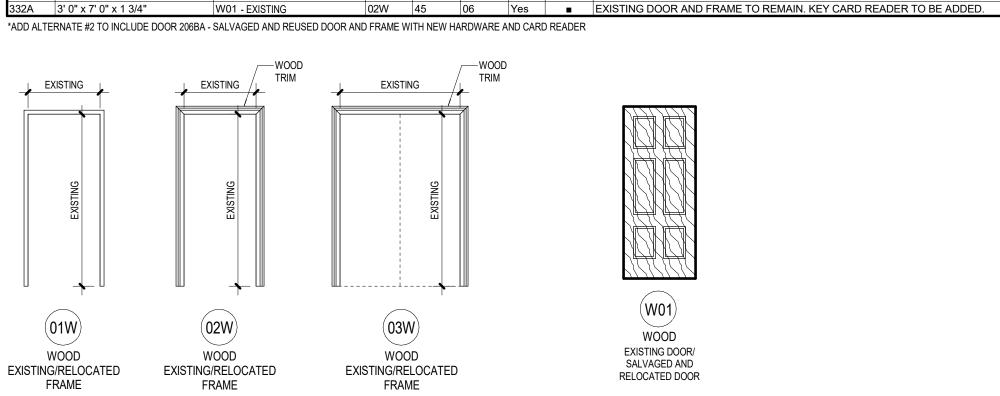

DOOR SIZE


W01 - SALVAGED AND REUSED 03W

W01 - EXISTING

PR. 3' 0" x 7' 0" x 1 3/4"

1' 0" / 3' 0" x 7' 0" x 1 3/4"

PR. 2' 6" x 7' 0" x 1 3/4"

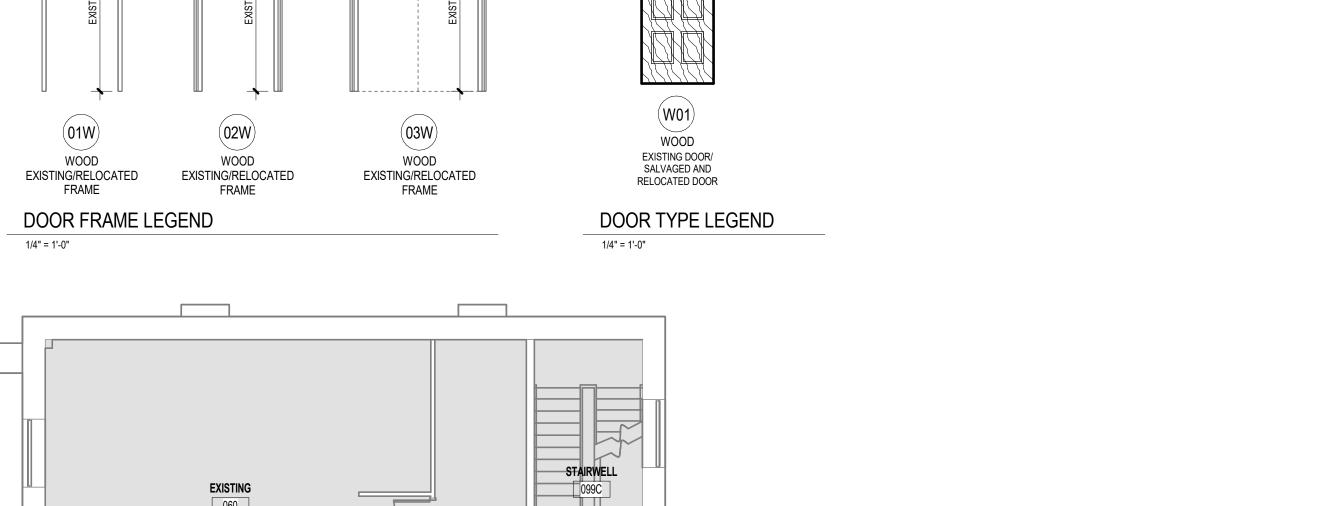

DOOR & FRAME SCHEDULE

REMARKS

■ EXISTING DOOR AND FRAME TO REMAIN. NEW ADA COMPLIANT HARDWARE WITH KEY CARD ACCESS.

■ EXISTING DOOR AND FRAME TO REMAIN. NEW ADA COMPLIANT HARDWARE WITH KEY CARD ACCESS.

■ EXISTING PAIR OF DOORS AND FRAME TO REMAIN. NEW ADA COMPLIANT HARDWARE WITH KEY CARD ACCESS.


■ EXISTING PAIR OF DOORS AND FRAME TO REMAIN. NEW ADA COMPLIANT HARDWARE WITH KEY CARD ACCESS.


RELOCATED PAIR OF DOORS, FRAME TRIM AND HARDWARE FROM ROOM 260.

EXISTING DOOR AND FRAME TO REMAIN. CLOSER AND DOOR SWEEP TO BE ADDED.

EXISTING DOOR, FRAME, AND HARDWARE TO REMAIN

■ EXISTING DOOR AND FRAME TO REMAIN. KEY CARD READER TO BE ADDED.

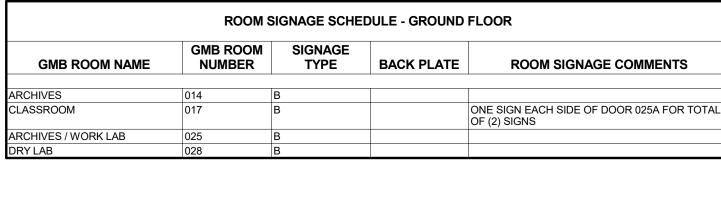

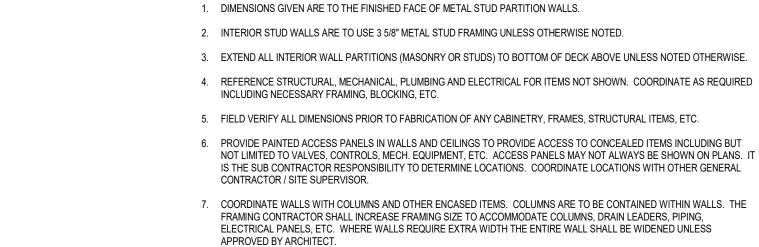

GENERAL FLOOR PLAN NOTES:

5. FIELD VERIFY ALL DIMENSIONS PRIOR TO FABRICATION OF ANY CABINETRY, FRAMES, STRUCTURAL ITEMS, ETC. 6. PROVIDE PAINTED ACCESS PANELS IN WALLS AND CEILINGS TO PROVIDE ACCESS TO CONCEALED ITEMS INCLUDING BUT NOT LIMITED TO VALVES, CONTROLS, MECH. EQUIPMENT, ETC. ACCESS PANELS MAY NOT ALWAYS BE SHOWN ON PLANS. IT IS THE SUB CONTRACTOR RESPONSIBILITY TO DETERMINE LOCATIONS. COORDINATE LOCATIONS WITH OTHER GENERAL

7. COORDINATE WALLS WITH COLUMNS AND OTHER ENCASED ITEMS. COLUMNS ARE TO BE CONTAINED WITHIN WALLS. THE FRAMING CONTRACTOR SHALL INCREASE FRAMING SIZE TO ACCOMMODATE COLUMNS, DRAIN LEADERS, PIPING,

8. PROVIDE MINIMUM CLEARANCES AT ALL DOORS PER DETAILS. SEE G0.01 FOR REQUIREMENTS.


9. FOR ALL CABINETRY, SEE INTERIOR ELEVATIONS FOR LAYOUTS. FIELD VERIFY CLEAR WIDTHS PRIOR TO FABRICATION. G.C. TO COORDINATE AND PROVIDE BLOCKING IN WALL AS NECESSARY FOR ALL WALL MOUNTED CABINETRY. 10. CONTRACTOR TO MAINTAIN / REPAIR RATING OF EXISTING PARTITIONS AS AFFECTED BY DEMOLITION / NEW

CONSTRUCTION. TYPICAL THROUGHOUT. 11. SEAL ALL PENETRATIONS IN FIRE RATED FLOORS AND WALLS WITH APPROVED FIRESTOPPING.


12. WALLS TO BE PATCHED WITH LIKE MATERIALS WHERE EXISTING WALLS HAVE BEEN COMPROMISED FROM DEMOLITION. THIS SHALL INCLUDE, BUT NOT BE LIMITED TO REMOVAL AND REINSTALLATION OF CASEWORK AND WALL

MOUNTED EQUIPMENT IN ORDER TO ACHIEVE SAID PATCH. 13. ALL FURNITURE TO BE PROVIDED BY OWNER'S FURNITURE VENDOR.


14. CASEWORK AND ALL ASSOCIATED ITEMS (INCL BUT NOT LIMITED TO COUNTERTOPS, PLUMBING FIXTURES, UNDERCABINET LIGHTS, ETC.) IN ROOMS 260, 330 AND 332 TO BE PROVIDED BY OWNER'S CASEWORK VENDOR. CONTRACTOR IS RESPONSIBLE FOR ROUGH-IN AND FINAL CONNECTIONS TO PLUMBING FIXTURES. CONTRACTOR IS RESPONSIBLE FOR ROUGH-IN AND DEVICES FOR ALL UNDERCABINET LIGHTS (AND MATERIAL/INSTALLATION OF POWER/RACEWAY ON ISLAND IN

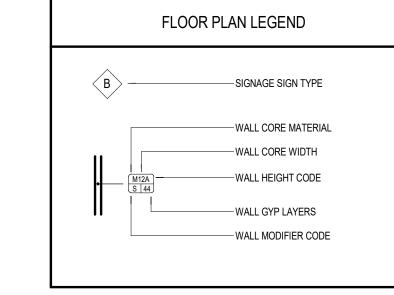

-ALL WALLS TO BE S3A-A-11 UNLESS NOTED OTHERWISE -FIRE RATINGS AS CALLED FOR ON CODE COMPLIANCE PLAN -REFER TO SHEET A7.2 PARTITION TYPES FOR WALL TYPE CODES AND DETAILS

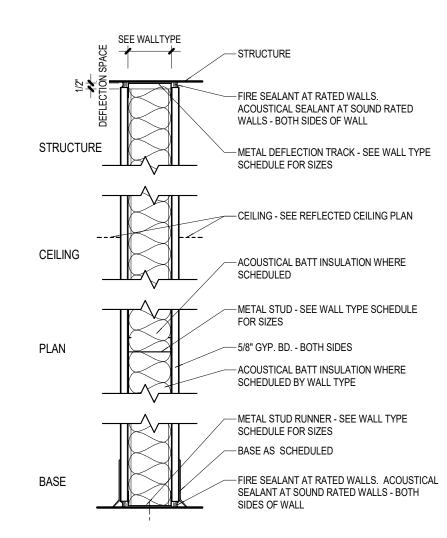

		WALL CORE MATERIAL		MATERIAL WIDTH		WALL HEIGHT CODE		WALL MODIFIER CODE		WALL GYPSUM BOARD LAYER	
	CODE	MATERIAL	CODE	WIDTH	CODE	DESCRIPTION		CODE	DESCRIPTION	CODE	DESCRIPTION
	S	METAL STUDS	0	7/8" FURRING CHANNEL	Α	TO UNDERSIDE OF	7 F		(BLANK) NO MODIFIER		(BLANK) = NO GYP BD
ı			1	1 5/8" METAL STUD		STRUCTURAL DECK	1 [
			2	2 1/2" METAL STUD				Α	SOUND ATTENUATION BATTS	01	(0) + (1)
			3	3 5/8" METAL STUD	В	TO 6" ABOVE CEILING					
							П	F	FIRE RATED ASSEMBLY	11	(1) + (1)
					D	EXISTING WALL OPENING INFILL	I				
	NOTE: A	LL WALLS TO BE S3A-A-11 UN	LESS NOTI	ED OTHERWISE.							

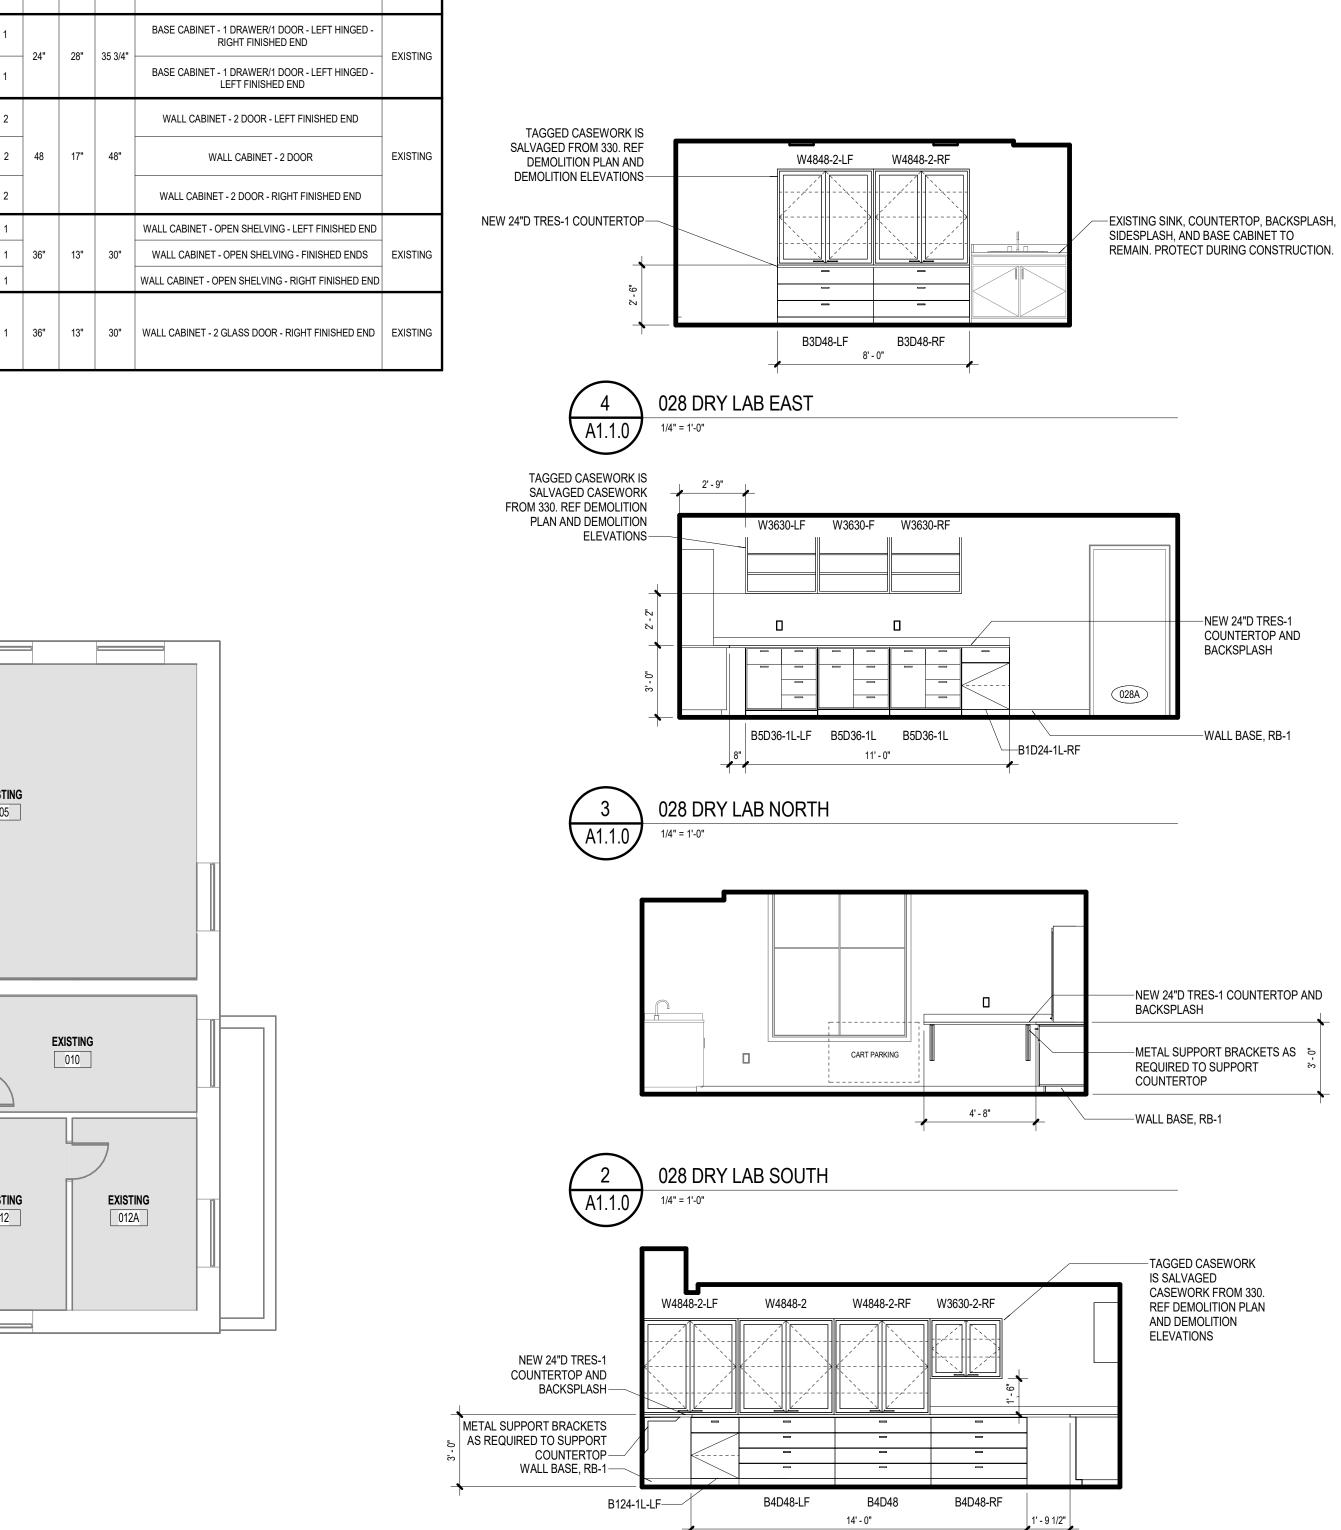

028 DRY LAB WEST

1/4" = 1'-0"

